



LIGHTHOUSE SS POWER PEDESTAL



Lighthouse-SS Power Pedestal




Dimensions

Height: 44.00" (1117.60 mm)
Width: 9.565" (242.95 mm)
Depth: 9.875" (250.83 mm)

Approximate
Weight: 60 lbs. (27.2 kg)

UL FILE # E133781

Lighthouse-SS Base Diagram

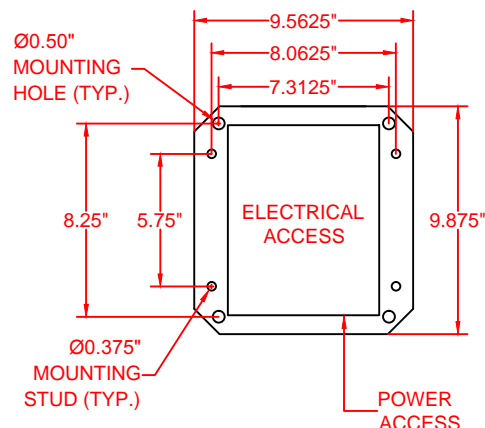

General Specifications for Lighthouse-SS Power Pedestals

All Power Pedestals Must Meet the Following:

Part I. General:

1.1 General Requirements:

- A. Shall be tested and certified to be in compliance with ANSI/UL 231 entitled "power outlets."
- B. If a laboratory other than U.L. is used that laboratory must certify, in writing, that the power outlet has been tested and meets all of the requirements of ANSI/UL 231, **including 746C polymeric materials, and that the unit will pass the 94VO-5V flame test.**
- C. Shall be certified to meet all sections of NFPA 303 DTD "2011 Marinas and Boatyards."
- D. Shall meet 406.8 (B)(2)(a) of the national electric code NFPA 70, i.e. "A receptacle installed in a wet location shall be installed in a weatherproof enclosure, the integrity of which is not affected when the attachment plug cap is inserted."

Part II. Products:

2.1 Acceptable Manufacturers - Power Pedestal / Distribution Equipment:

- A. Dock Boxes Unlimited, Inc.
www.dockboxes.com
Toll Free: 1-800-559-4269

2.2 Power Pedestal - General Specification

- A. Main Housing:
 - a. The housing shall be constructed of 16 gauge, 316L low carbon stainless steel and shall be coated with UV-resistant polyester resin powder coating. It shall be UL listed as a type 3R weatherproof enclosure.

B. Lighting Assembly / Housing:

- a. The lighting top housing shall be constructed of 1/8" thick injection molded heavy resin material and shall be coated with a UV-resistant water based acrylic polymer. It shall be UL listed as a type 3R weatherproof enclosure.
- b. STANDARD - Each pedestal shall be equipped with a non-metered LED light, that is controlled by an electromechanical photocell and protected by a 20 amp, single pole breaker.
- c. OPTION - Each pedestal shall be equipped with a non-metered light. The lighting assembly shall include one 14-watt compact fluorescent light, that is controlled by an electromechanical photocell and protected by a 20 amp, single pole breaker.

C. Wiring:

- a. The power pedestal shall be completely pre-wired at the factory to the load side of the compression lug assembly.
- b. All load copper wiring shall be of high stranding and tin plated to resist corrosion.
- c. The maximum size of the line wiring shall be 350 MCM direct feed or #4/0 loop feed.

D. Loop Feed Bus Bar System:

- a. STANDARD - 250 Amp Bus Bar - The bus system shall be of stud compression terminal type using a 3/8" - silicon-bronze stud with a silicon-bronze Belleville type washer. The 3/8" - silicon-bronze hex-nut shall be torqued to 150 inch-pounds with a maximum amperage rating of 250 amps.
- b. OPTION - Single and double barrel mechanical bus bars - rated for copper or aluminum - are also available in sizes ranging from #8 to 350MCM.

E. Grounding:

- a. All exposed metallic parts must have an integral ground that is a part of the equipment grounding system.

F. Receptacles:


- a. All receptacles shall be mounted behind a lockable weatherproof, hinged door that is under tension to ensure proper closing pressure when the receptacle is or is not in use.
- b. OPTION- Receptacles may remounted behind hinged, self closing polyvinyl gasketed cover.
- c. All receptacles under 60 amps shall be of the corrosion resistant type conforming to NEMA L-5 and/or NEMA L-6 requirements and are rated for marine use.
- d. All receptacles over 60 Amp receptacles shall conform to IEC and CEE standards.
- e. 20 Amp, 110 Volt, straight blade receptacles shall be GFI protected.
- f. 20 Amp, 125 Volt, twist-lock receptacles shall be 2 pole, 3 wire (NEMA L5-20).
- g. 30 Amp, 125 Volt, twist-lock receptacles shall be 2 pole, 3 wire (NEMA L5-30).
- h. 50 Amp, 125 Volt, twist-lock receptacles shall be 2 pole, 3 wire (NEMA SS-1).
- i. 50 Amp, 125/250 Volt, twist-lock receptacles shall be 3 pole, 4 wire (NEMA SS-2).
- j. 100 Amp, 125/250 Volt, pin-and-sleeve receptacles shall be 3 pole, 4 wire.
- k. 100 Amp, 120/208 Volt, pin-and-sleeve receptacles shall be 4 pole, 5 wire.

- l. 100 Amp, 480 Volt, pin-and-sleeve receptacles shall be 3 pole, 4 wire.
 - m. 100 Amp, 277/480 Volt, pin-and-sleeve receptacles shall be 4 pole, 5 wire.
- G. Circuit Breakers:
- a. All breakers for receptacles shall be of the thermal magnetic type, 10,000 A.I.C., and shall be UL listed.
 - b. OPTION- Circuit breakers shall be located under lockable, weatherproof door cover.
 - c. Circuit breakers for the 20 Amp, 110 Volt, straight blade receptacles and the 20 Amp, 125 Volt, twist-lock receptacles shall be single pole, 20 Amp, 30mA.
 - d. Circuit Breakers for the 30 Amp, 125 Volt, twist-lock receptacles shall be single pole, 30 Amp, 30mA.
 - e. Circuit Breakers for the 50 Amp, 125 Volt, twist-lock receptacles shall be single pole, 50 Amp.
 - f. Circuit breakers for the 50 Amp, 125/250 Volt, twist-lock receptacles shall be two pole, 50 Amp.
 - g. Circuit breakers for the 100 Amp, 125/250 Volt, pin-and-sleeve receptacles shall be two pole, 100 Amp.
 - h. Circuit breakers for the 100 Amp, 120/208 Volt, pin-and-sleeve receptacles shall be three pole, 100 Amp.
 - i. Circuit breakers for the 100 Amp, 480 Volt, pin-and-sleeve receptacles shall be three pole, 100 Amp.
 - j. Circuit breakers for the 100 Amp, 277/480 Volt, pin-and-sleeve receptacles shall be three pole, 100 Amp.
- H. Hose/Cable Bracket:
- a. Each pedestal shall have aluminum brackets capable of holding a 50' length of 5/8" water hose or 50' of 50 Amp, four-conductor boat S.O. cord.
- I. Metering (Optional):
- a. 120 Amp Meter - The pedestals may be equipped with fully electronic meters that display the kilowatts used at each slip on a non-resettable counter that is protected from the weather. The accuracy of the meters must be certified by the manufacturer to have a 120 ampere rating and no more than a 2% error when tested in accordance with ANSI.-C12.1.(California requires 1%).
 - b. 200 Amp Meter - The pedestals shall be equipped with fully electronic meters that display the kilowatts used at each slip on a non-resettable counter that is protected from the weather. The accuracy of the meters must be certified by the manufacturer to have a 200 ampere rating and no more than a 2% error when tested in accordance with ANSI.-C12.1.(California requires 1%).
- J. Communications (Optional):
- a. Each pedestal may be equipped with up to 4 outlets for each slip. Each outlet shall contain a combination of RJ45 (internet) receptacles, RJ11 (telephone) receptacles, or male coax (cable TV) connectors under an injection-molded heavy resin, weather protective cover.


-
- b. Each communication assembly shall include an internal isolation box for the separation of high and low voltage equipment.
 - K. Water (Optional):
 - a. Each pedestal may be equipped with one or two 3/4" ball valves with each having a single 3/4" female NPT fitting.
 - b. The water assembly shall have an isolation box, which separates the water connections from the electrical access area.
 - L. Power Pedestals for A.D.A. Slips (Designated as Handicap Accessible) :
 - a. Power pedestals installed on designated handicap accessible slips shall comply with the guidelines of the Americans With Disabilities Act of 1990.

(END OF SECTION - SEE SPECS BELOW)


Product Features

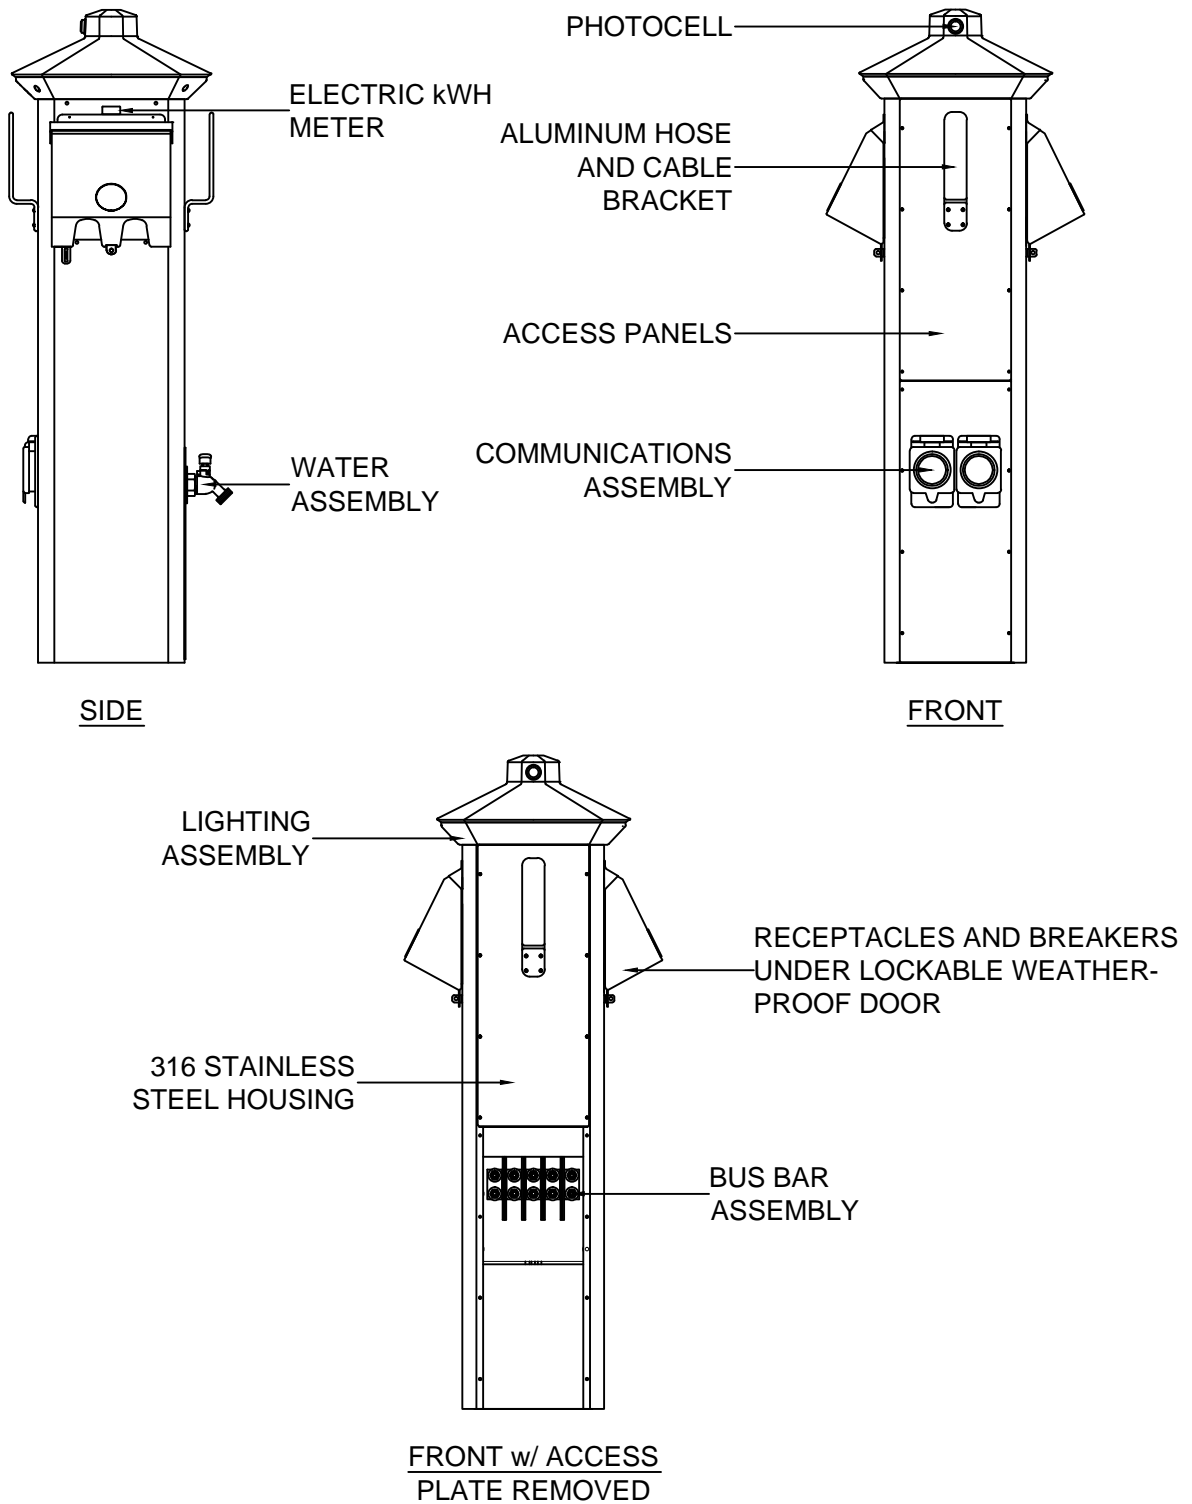

Dimensions

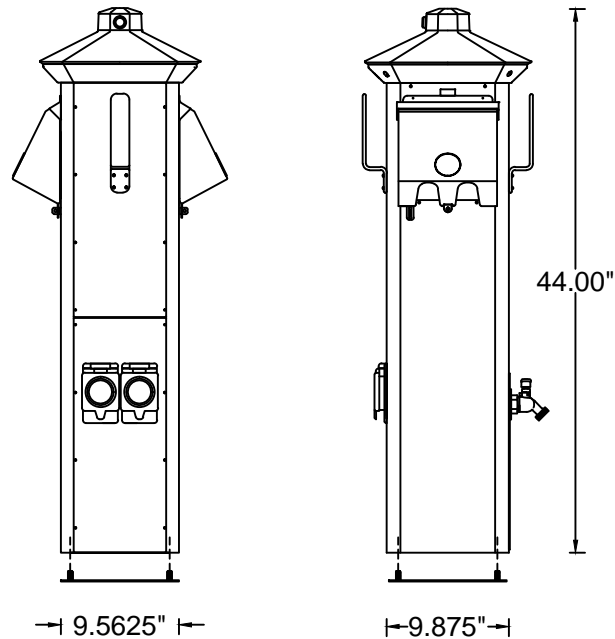

Base Dimensions

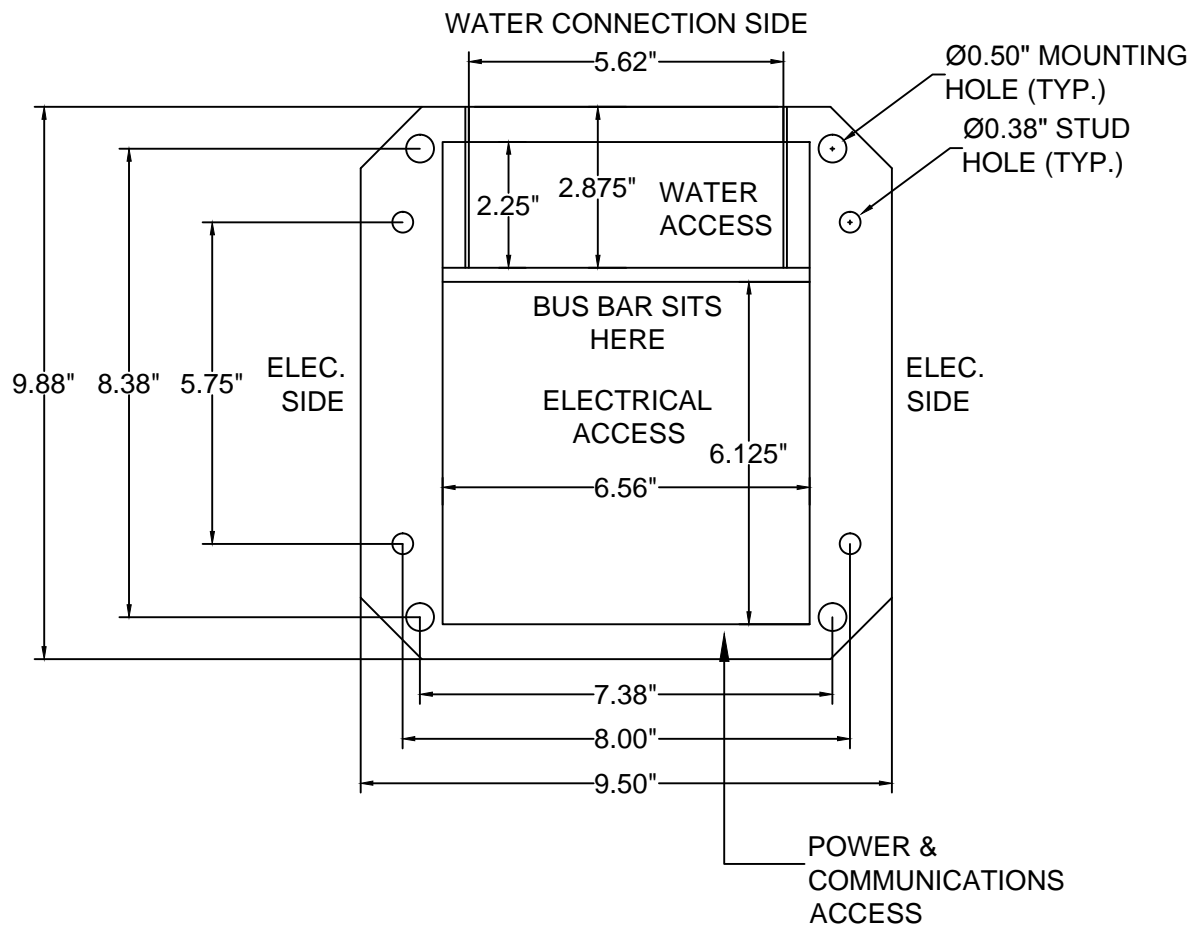

Wiring Diagram - Stud Lug Bus Bar

Wire Colors Per NEC

Line 1	L1	Black
Neutral	N	White
Line 2	L2	Red
Line 3	L3	Blue
Ground	G	Green



Compression Terminals (Not Included)

Contractor needs to terminals to line wires and place on provided stud lug connector. Max width of compression lug pad to be X.

BUS BAR WITH STUD
LUG COMPRESSION
TERMINAL - TORQUE
BRONZE NUT TO 150
IN. LBS.

CONDUIT OR
APPROVED CABLE
WITH FOAMING
SILICONE SEALANT
AT WIRE ENTRY / EXIT

INCOMING CONDUIT
OR APPROVED CABLE

14.50"

INCOMING CONDUIT
OR APPROVED CABLE

UTILITY ROUTING AREA

Wiring Diagram - Aluminum Mechanical Bus Bar

Wire Colors Per NEC

Line 1	L1	Black
Neutral	N	White
Line 2	L2	Red
Line 3	L3	Blue
Ground	G	Green

CONDUIT OR
APPROVED CABLE
WITH FOAMING
SILICONE SEALANT
AT WIRE ENTRY / EXIT


14.50"

INCOMING CONDUIT
OR APPROVED CABLE

INCOMING CONDUIT
OR APPROVED CABLE

UTILITY ROUTING AREA

Water Assembly

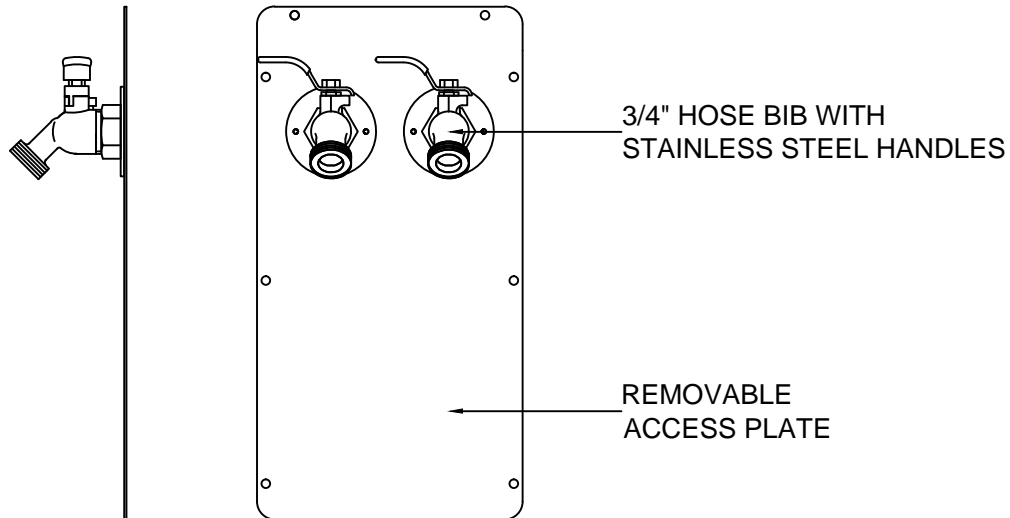

Communications

COMMUNICATION ASSEMBLIES
INCLUDE ISOLATION BOXES
FOR INTERNAL CONNECTIONS

CONNECTIONS AVAILABLE:

- MARINE TWIST-LOCK TELEPHONE
- RJ-12 CAT3 TELEPHONE JACK (HOUSEHOLD PHONE)
- RJ-45 CAT5 HIGH-SPEED INTERNET JACK
- COAX CABLE TV FCF FEMALE CONNECTION
- OTHER CONNECTIONS AVAILABLE UPON REQUEST

